

# EVM3632C-QV-00B

18V Input 3A Module Step-Down Converter Evaluation Board

#### DESCRIPTION

The EVM3632C-QV-00B Evaluation Board is designed to demonstrate the capabilities of MPS' MPM3632C, a step-down regulator module integrated with a synchronous, rectifying power MOSFET, inductor, and three capacitors. The MPM3632C offers a very compact solution that requires only input and output capacitors to achieve 3A of continuous output current with excellent load and line regulation over a wide input range.

The MPM3632C operates at a fixed 3MHz switching frequency and employs constant-on-time (COT) control, which provides a fast load transient response.

Full protection features include output overvoltage protection (OVP), over-current protection (OCP), and thermal shutdown.

The MPM3632C is available in a space-saving QFN-20 (3mmx5mmx1.6mm) package.

#### **ELECTRICAL SPECIFICATION**

| Parameter      | Symbol           | Value | Units |
|----------------|------------------|-------|-------|
| Input Voltage  | $V_{IN}$         | 12    | V     |
| Output Voltage | V <sub>OUT</sub> | 3.3   | V     |
| Output Current | I <sub>OUT</sub> | 3     | Α     |

#### **FEATURES**

- Complete Switch-Mode Power Supply
- 3MHz Switching Frequency
- Wide 4V to 18V Operation Input Range
- Output Adjustable from 0.8V
- Internal Fixed Soft-Start Time
- 3A Continuous Output Current
- Forced CCM for Low Output Ripple
- Power Good Indicator (PG)
- Hiccup Over-Current Protection (OCP)
- Output Over-Voltage Protection (OVP)
- Thermal Shutdown
- Fast Transient Response
- Available in a QFN-20 (3mmx5mmx1.6mm)
  Package
- Total Solution Size: 7mmx7.9mm

### **APPLICATIONS**

- Server Systems
- Medical and Imaging Equipment
- Distributed Power Systems
- Point of Load for FPGA, ASICs, DSPs
- Space Constrained Applications

All MPS parts are lead-free, halogen free, and adhere to the RoHS directive. For MPS green status, please visit MPS website under Quality Assurance.

"MPS" and "The Future of Analog IC Technology" are Registered Trademarks of Monolithic Power Systems, Inc.


## **EVM3632C-QV-00A EVALUATION BOARD**



 $(L \times W \times H)$  64mm  $\times$  64mm  $\times$  1.6mm


| Board Number    | MPS IC Number |  |  |
|-----------------|---------------|--|--|
| EVM3632C-QV-00B | MPM3632CGQV   |  |  |

# Efficiency &Ploss vs. Load Current





## **EVALUATION BOARD SCHEMATIC**

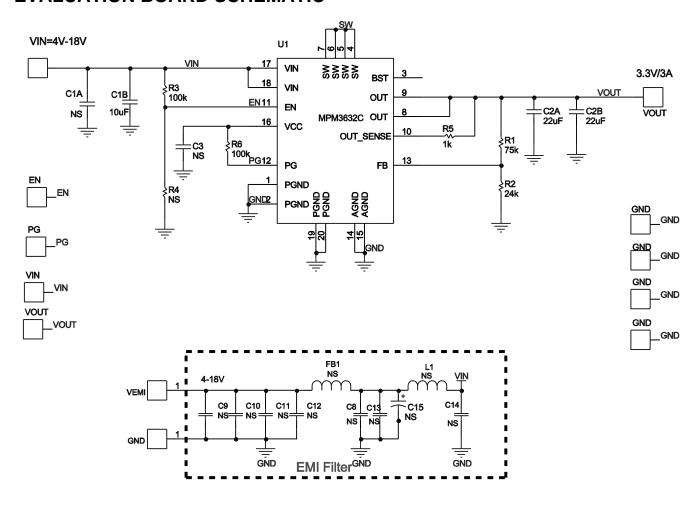


## **EVM3632C-QV-00B BILL OF MATERIALS**


| Qty | Designator | Value | Description           | Package | Manufacturer | Manufacturer P/N   |
|-----|------------|-------|-----------------------|---------|--------------|--------------------|
| 1   | C1B        | 10µF  | Ceramic Cap.,25V,X5R  | 0805    | Murata       | GRM21BR61E106MA73L |
| 2   | C2A,C2B    | 22µF  | Ceramic Cap.,16V,X5R  | 0805    | TDK          | C2012X5R1C226K     |
| 1   | R1         | 75k   | Film Res,1%,0402,75K  | 0402    | YAGEO        | RC0402FR-0775KL    |
| 1   | R2         | 24K   | Film Res,1%,0402,24K  | 0402    | YAGEO        | RC0402FR-0724KL    |
| 1   | R5         | 1k    | Film Res,1%,0402,1K   | 0402    | YAGEO        | RC0402FR-071KL     |
| 2   | R3,R6      | 100k  | Film Res,1%,0402,100K | 0402    | YAGEO        | RC0402FR-07100KL   |




#### **EVB TEST RESULTS**

Performance waveforms are tested on the evaluation board.  $V_{IN} = 12V$ ,  $V_{OUT} = 3.3V$ ,  $T_A = 25$ °C, unless otherwise noted.

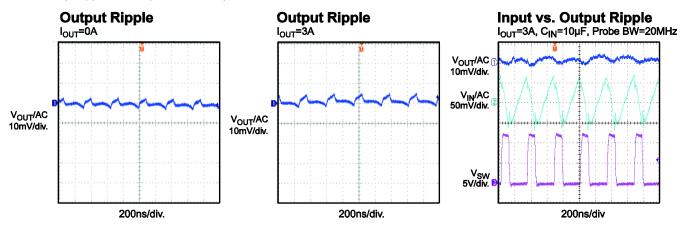

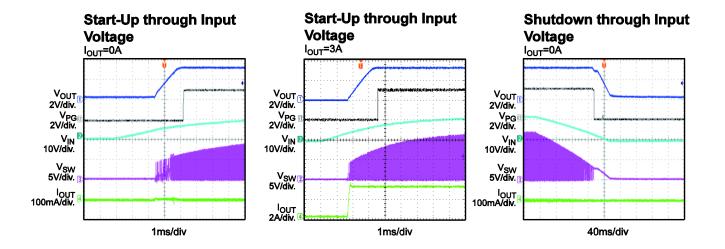


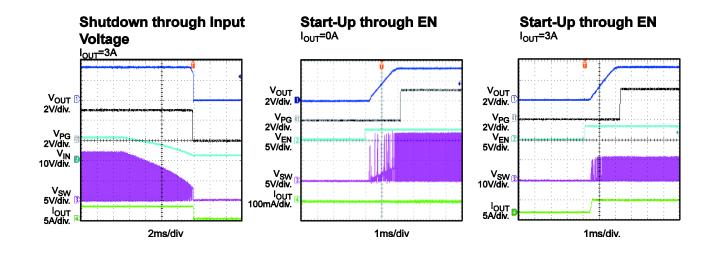





## **EVB TEST RESULTS** (continued)

Performance waveforms are tested on the evaluation board.  $V_{IN} = 12V$ ,  $V_{OUT} = 3.3V$ ,  $T_A = 25$ °C, unless otherwise noted.

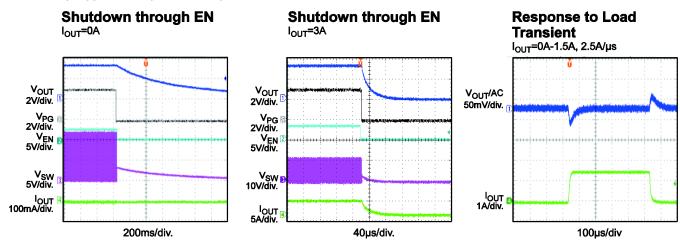

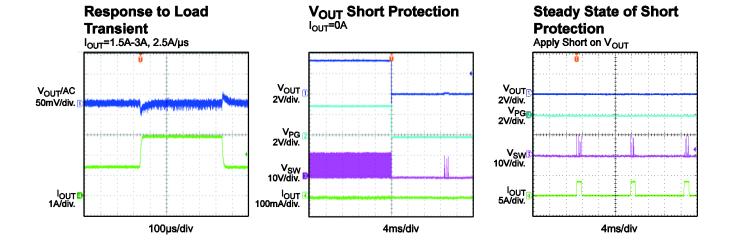







## PRINTED CIRCUIT BOARD LAYOUT




Figure 1: Top Silk Layer




Figure 3: Mid Layer1




Figure 2: Top Layer




Figure 4: Mid Layer2




Figure 5: Bottom Layer



## **QUICK START GUIDE**

- 1. Preset Power Supply to  $4V \le V_{IN} \le 18V$ .
- 2. Turn Power Supply off.
- 3. Connect Power Supply terminals to:
  - a. Positive (+): VIN
  - b. Negative (-): GND
- 4. Connect Load to:
  - a. Positive (+): VOUT
  - b. Negative (-): GND
- 5. Turn Power Supply on after making connections. The board will automatically start up.

**NOTICE:** The information in this document is subject to change without notice. Please contact MPS for current specifications. Users should warrant and guarantee that third party Intellectual Property rights are not infringed upon when integrating MPS products into any application. MPS will not assume any legal responsibility for any said applications.